

ENERGY AND EXERGY ANALYSIS OF A COMBINED REFRIGERATION AND WASTE HEAT DRIVEN ORGANIC RANKINE CYCLE SYSTEM

by

Ertugrul CIHAN** and *Baris KAVASOGULLARI

Department of Mechanical Engineering, Osmaniye Korkut Ata University, Osmaniye, Turkey

Original scientific paper

<https://doi.org/10.2298/TSCI150324002C>

Energy and exergy analysis of a combined refrigeration and waste heat driven organic Rankine cycle system were studied theoretically in this paper. In order to complete refrigeration process, the obtained kinetic energy was supplied to the compressor of the refrigeration cycle. Turbine, in power cycle, was driven by organic working fluid that exits boiler with high temperature and pressure. Theoretical performances of proposed system were evaluated employing five different organic fluids which are R123, R600, R245fa, R141b, and R600a. Moreover, the change of thermal and exergy efficiencies were examined by changing the boiling, condensing, and evaporating temperatures. As a result of energy and exergy analysis of the proposed system, most appropriate organic working fluid was determined as R141b.

Key words: *energy, exergy, organic Rankine cycle, waste heat, refrigeration cycle*

Introduction

The systems, which convert various heat energy into electrical energy, are called organic Rankine cycle (ORC). In organic Rankine systems, organic compounds are used as working fluid instead of water. Organic Rankine systems have a very important place in converting low or middle grade waste heat or natural energy sources into useful electrical energy and have several advantages over the traditional Rankine cycles which use water as working fluid. First of all, in ORC systems, high molecular weighted, low corrosive, low critical temperature and low critical pressure organic compounds are used as working fluid. Fluid molecules collide turbine blades with low speed because of high molecular weight of the working fluid and this is important for the turbine life. Another advantage is low thermal and mechanical stress on the system equipment because of low temperature and pressure of the working fluid. These and similar advantages make attractive the ORC systems when generating power from low and middle grade heat sources.

Like other power generating systems, exergy and energy performance analysis has an important place in feasibility study of the ORC systems. There are several studies on the ORC systems about performance and working fluid selection. Zhu *et al.* [1] analyzed performance of an ORC system by using dry, isentropic, and wet fluids. Evaporation pressure, condensing pressure, outlet temperature of hot fluid, net power, thermal efficiency, total cycle irreversible loss, and total heat recovery efficiency parameters of the system have been investigated with

* Corresponding author, e-mail: ertugrul.cihan@osmaniye.edu.tr

critical temperatures of the fluids and by changing evaporation temperatures. In another study, Kaska [2], analyzed energy and exergy of an organic Rankine system which is used in waste heat recovery in steel industry. The variation of energy and exergy parameters of the system has been examined by changing outlet temperature of the heat source, evaporator pressure, superheating, dead state temperature, and condenser pressure of the system. Ozdil *et al.* [3] thermodynamically analyzed ORC system that is located in southern of Turkey with actual plant data. In the analysis relationship between pinch point temperature and exergy efficiency was observed and as a result of the study, it is specified that, exergy efficiency will increase if the pinch point temperature is decreased. In a different study, ORC system has been used in a 12 liter Diesel engine to recover waste exhaust gas and as cooler for the engine by Tahani *et al.* [4]. The system analyzed for maximizing power generation from ORC system with using waste exhaust gas to evaporate organic fluid and hot water of the engine is used to actualize preheating the organic fluid in ORC system. Many studies have been done about using geothermal, solar or waste heat sourced ORC systems [5-9].

In this study, a typical refrigeration cycle is combined with a waste heat sourced ORC system. Generated power in ORC system is provided to the compressor in refrigeration system to complete cooling process. Similar system is analyzed theoretically by Cihan [10], using dry and isentropic fluids which are R600, R600a, R601, and R245fa, in the manner of coefficient of performances of power and refrigeration cycle and first law efficiency of thermodynamics. In another similar study, Lian *et al.* [11] investigated the change of overall system coefficient of performances, compression and expansion ratios in compressor and turbine due to boiling, evaporation and condensation temperatures for four different organic fluid (R290, R600, R600a, and R1270). There are different studies about this subject using ejector instead of compressor in refrigeration cycle [12-14].

In organic Rankine systems fluid selection is important and many studies have been done to specify proper type of fluid and many researchers have suggested dry or isentropic

fluids for this type of systems [15-16]. In expansion process at turbine, condensation may occur when temperature and pressure of working fluid decrease. This causes reduction in turbine life if liquid molecules of working fluid collide with turbine blades. Because of that reason, in this study dry, R600, R600a, R245fa, R123 and isentropic, R141b, organic fluids have been used as working fluid. Thermophysical properties of working fluids which used in the system are shown in tab. 1. As it

Table 1. Thermophysical properties of working fluids used in cycle

Working fluid	Type of fluid	Molecular mass [gmole ⁻¹]	Critical temperature [K]	Critical pressure [MPa]
R600a	Dry	58.12	407.8	3.63
R600	Dry	58.12	425.1	3.8
R245fa	Dry	134.05	427.2	3.64
R123	Dry	152.93	456.8	3.66
R141b	Isentropic	116.95	477.5	4.21
R718	Wet	18.00	647.1	22.00

seems from table, critical pressures and temperatures of the working fluids are less than R718 (Water). On the contrary, molecular masses of these working fluids are higher than R718.

System description

The schematic diagram of the combined refrigeration and ORC is shown in fig. 1. As it shown in the figure, the system consists of evaporator, compressor, expansion valve in refrigeration cycle and pump, boiler, turbine in ORC. The system has a condenser for common

use in refrigeration and ORC. Power is generated in turbine by high temperature and pressure working fluid and delivered to the compressor to complete refrigeration process by a mechanical shaft. Processes in the system can be listed:

- 1-2 compression process in compressor.
- 3-4 reducing pressure of working fluid at constant enthalpy in expansion valve.
- 4-1 heat addition to the working fluid at constant temperature from cooled medium.
- 3-5 increasing pressure of liquid fluid in pump.
- 5-6 heat addition process at constant temperature by using waste heat source in boiler.
- 6-7 generating power in turbine by using high temperature and pressure fluid vapor.
- 8-3 heat rejection to the cold source at constant temperature in condenser.
- 2-7-8 adiabatic mixing of compressor and turbine leaving fluid at mixing chamber.

The T-s diagram of the purposed system for R123 is shown in fig. 2. Boiling temperature, evaporation temperature, and condensing temperature, are 100 °C, 0 °C, and 45 °C, respectively.

Theoretical calculations

As it seems from fig. 2, to simplify calculations, saturated state is assumed at evaporator, boiler and condenser exit, and heat and friction losses in the system are neglected. Calculations are carried out with the aid of EES software [17]. For the purposed system, shown in fig. 1, mathematical model is given below.

The thermal efficiency of the ORC system η_{ORC} can be defined:

$$\eta_{\text{ORC}} = \frac{\dot{W}_{\text{turb}}}{\dot{Q}_{\text{boi}} + \dot{W}_{\text{pump}}} \quad (1)$$

The \dot{W}_T , \dot{Q}_B , and \dot{W}_p will be calculated from following equations:

$$\dot{W}_{\text{turb}} = \eta_{\text{turb,isen}} \eta_{\text{turb,mec}} \dot{W}_{\text{turb,isen}} \quad (2)$$

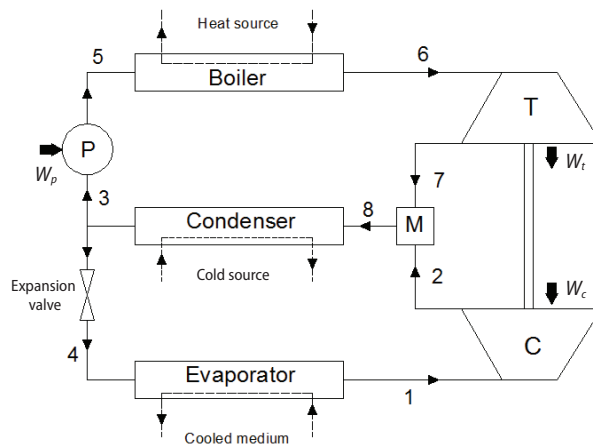


Figure 1. Schematic diagram of combined refrigeration and ORC; T – turbine, P – pumpe, C – compressor, M – mixing chamber

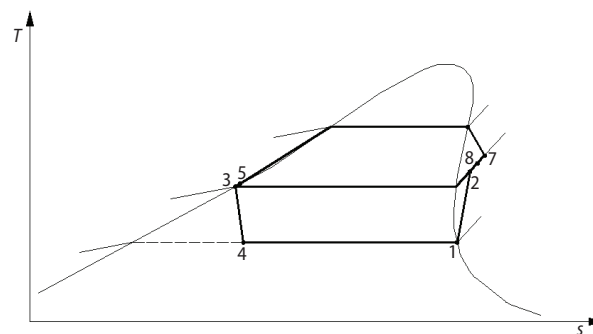


Figure 2. The T-s diagram of the combined refrigeration and ORC system for R123

$$\dot{Q}_{\text{boi}} = \dot{m}_{\text{ORC}}(h_6 - h_5) \quad (3)$$

$$\dot{W}_{\text{pump}} = \frac{\dot{m}_{\text{ORC}}(h_5 - h_3)}{\eta_{\text{pump}}} \quad (4)$$

The coefficient of performance of refrigeration cycle can be defined:

$$COP_C = \frac{\dot{Q}_{\text{eva}}}{\dot{W}_{\text{comp}}} \quad (5)$$

The \dot{Q}_{eva} and \dot{W}_C can be found from following equations:

$$\dot{Q}_{\text{eva}} = \dot{m}_{\text{ref}}(h_1 - h_4) \quad (6)$$

$$\dot{W}_{\text{comp}} = \frac{\dot{W}_{c,\text{isen}}}{\eta_{c,\text{mec}} \eta_{c,\text{isen}}} \quad (7)$$

Heat rejected from condenser can be calculated by following equation:

$$\dot{Q}_{\text{con}} = (\dot{m}_{\text{ref}} + \dot{m}_{\text{ORC}})(h_8 - h_3) \quad (8)$$

Net power output from the turbine will be equal to net power input to the compressor. Hence, the following equation obtained:

$$\dot{W}_{c,\text{isen}} = \eta_{stc} \dot{W}_{t,\text{isen}} \quad (9)$$

The η_s can be defined with following equation:

$$\eta_{stc} = \eta_{c,\text{mec}} \eta_{c,\text{isen}} \eta_{t,\text{isen}} \eta_{t,\text{mec}} \quad (10)$$

Total system thermal efficiency, η_{sys} , can be defined by equation:

$$\eta_{\text{sys}} = \frac{\dot{Q}_{\text{eva}}}{\dot{Q}_{\text{boi}} + \dot{W}_{\text{pump}}} \quad (11)$$

Specific exergy flow of any state, ψ_i , can be defined:

$$\psi_i = h_i - h_0 - [T_0(s_i - s_0)] \quad (12)$$

Thus, exergy flows can be defined:

$$\dot{E}_i = \dot{m}_i \psi_i \quad (13)$$

Exergy destroyed in boiler and boiler exergy efficiency:

$$I_{\text{boi}} = \dot{m}_{\text{ORC}} T_0 \left[s_6 - s_5 - \left(\frac{Q_{\text{boi}}}{T_{\text{boi}}} \right) \right] \quad (14)$$

$$\eta_{e,\text{boi}} = 1 - \frac{I_{\text{boi}}}{\dot{E}_6 - \dot{E}_5} \quad (15)$$

Destroyed exergy in turbine and exergy efficiency of the turbine can be defined:

$$I_{\text{turb}} = \dot{E}_6 - \dot{E}_7 - \dot{W}_{\text{turb}} \quad (16)$$

$$\eta_{e,turb} = \frac{\dot{W}_{turb}}{\dot{E}_6 - \dot{E}_7} \quad (17)$$

Exergy destroyed in pump and exergy efficiency of the pump can be calculated:

$$I_{pump} = \dot{E}_5 - \dot{E}_3 + \dot{W}_{pump} \quad (18)$$

$$\eta_{e,pump} = \frac{\dot{E}_5 - \dot{E}_3}{\dot{W}_{pump}} \quad (19)$$

Exergy destroyed in compressor and exergy efficiency of the compressor:

$$I_{comp} = \dot{E}_2 - \dot{E}_1 + \dot{W}_{comp} \quad (20)$$

$$\eta_{e,comp} = \frac{\dot{E}_2 - \dot{E}_1}{\dot{W}_{comp}} \quad (21)$$

At expansion valve destroyed exergy can be defined:

$$I_{exp} = \dot{E}_3 - \dot{E}_4 \quad (22)$$

Destroyed exergy in the mixing chamber:

$$I_{mix} = \dot{E}_2 + \dot{E}_7 - \dot{E}_8 \quad (23)$$

Destroyed exergy at the evaporator and exergy efficiency of the evaporator can be defined:

$$I_{eva} = \dot{m}_{ref} T_0 \left[s_4 - s_1 - \left(\frac{Q_{eva}}{T_{eva}} \right) \right] \quad (24)$$

$$\eta_{e,eva} = 1 - \frac{I_{eva}}{\dot{E}_4 - \dot{E}_1} \quad (25)$$

Destroyed exergy at the condenser and exergy efficiency of the condenser can be calculated by:

$$I_{con} = (\dot{m}_{ref} + \dot{m}_{ORC}) T_0 \left[s_3 - s_8 + \left(\frac{Q_{con}}{T_{con}} \right) \right] \quad (26)$$

$$\eta_{e,con} = 1 - \frac{I_{con}}{\dot{E}_8 - \dot{E}_3} \quad (27)$$

Total system exergy efficiency can be defined by the equation:

$$\eta_{e,sys} = \frac{\dot{E}_C}{\dot{E}_{in}} \quad (28)$$

In eq. (28), \dot{E}_C and \dot{E}_{in} will be calculated from equations:

$$\dot{E}_C = \dot{E}_1 - \dot{E}_4 \quad (29)$$

$$\dot{E}_{in} = \dot{E}_6 - \dot{E}_5 + \dot{W}_p \quad (30)$$

In tab. 2, input parameters, including isentropic and mechanical efficiencies of components [18-20], and boundary conditions are listed to carry out calculations. As it seems from table, system has been investigated under variation of evaporator, condenser, and boiler temperatures.

Table 2. Input parameters and boundary conditions

Parameter	Typical value	Ranges
Working fluid mass flow rate in ref. cycle, \dot{m}_{ref}	1.0 kg/s	–
Dead state temperature, T_0	293 K	–
Dead state pressure, P_0	101.3 kPa	–
Evaporator temperature, T_{eva}	0 °C	–5 to 5 °C
Boiler temperature, T_{boi}	100 °C	90 to 120 °C
Condenser temperature, T_{con}	45 °C	40 to 50 °C
Turbine mechanical efficiency, $\eta_{t,mec}$	85%	–
Turbine isentropic efficiency, $\eta_{t,isen}$	75%	–
Compressor mechanical efficiency, $\eta_{c,mec}$	80%	–
Compressor isentropic efficiency, $\eta_{c,isen}$	70%	–
Pump isentropic efficiency, η_{pump}	80%	–

Results and discussion

Effect of the boiler temperature

To investigate effect of the boiler temperature, evaporator, and condenser temperatures are fixed at 0 °C and 45 °C, respectively. In fig. 3, variation of thermal efficiency of ORC, total system thermal efficiency and exergy efficiency of the total system vs. boiler temperature has been shown. Graphics indicate that, boiler temperature has positive effect on given system performance parameters for all decided working fluids. As shown in fig. 3(a), thermal efficiency of the ORC system will increase when boiler temperature increases. Since the desired input power to compressor is equal to output power of turbine, at high temperatures system can produce the same power with low mass flow rate in ORC. This causes reduction in \dot{Q}_{boi} and increase in thermal efficiency. The best performance has been shown by R141b since all working fluids are very close to each other. It seems from fig. 3(b) that, because of previous reason, total system thermal efficiency will be greater for all working fluids if boiler temperature increases. The R141b has greater values, over 30% efficiency, compare the other fluids, where the worst performance has been shown by R600a. Variation of exergy efficiency of the total system vs. boiler temperature has been shown in fig. 3(c). Figure indicates that for all decided working fluids exergy efficiency of the system becomes greater while boiler temperature increases. The R141b, again, shows the best performance with over 9.5% at 120 °C, while R600a has the smallest value of efficiency approximately 8.6% at the same temperature.

Effect of the evaporator temperature

The effect of the evaporator temperature on performance parameters is shown in fig. 4. At this time, boiler and condenser temperatures are fixed at 100 °C and 45 °C, respectively. In fig. 4(a), variation of COP values of the refrigeration cycle due to evaporator temperature has been shown. As it seems from figure, COP values become larger if the evaporator temperature increases. By using R141b, the greatest values can be obtained since the smallest values of COP

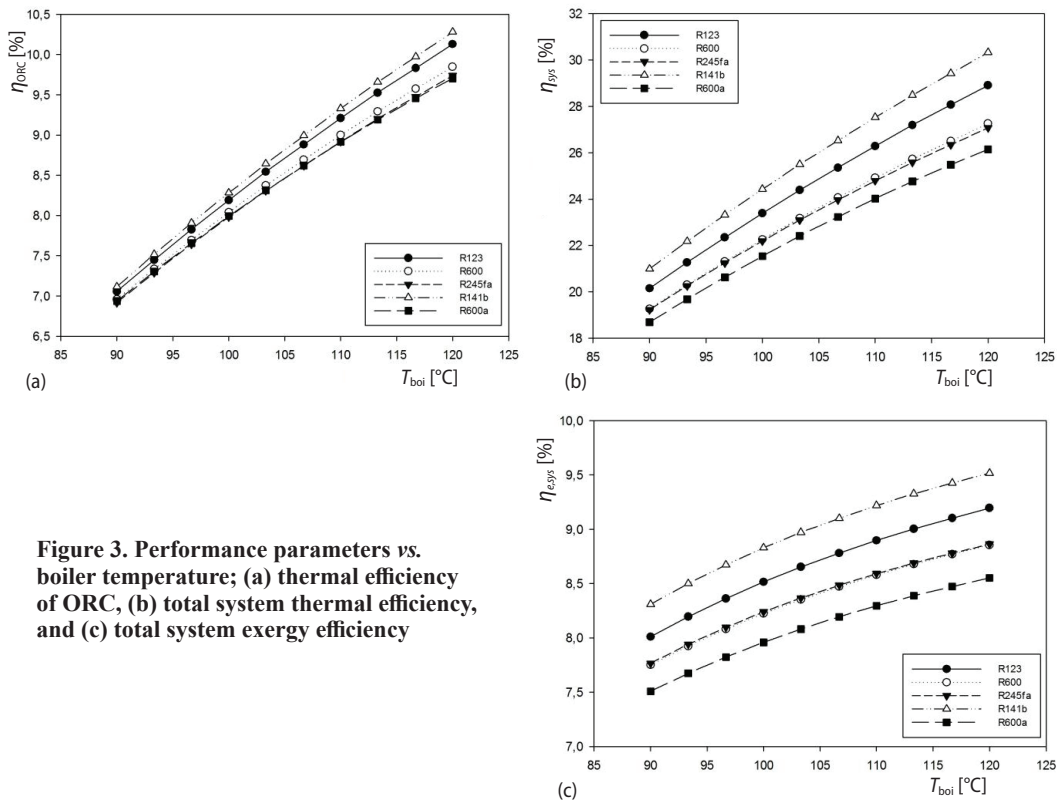


Figure 3. Performance parameters vs. boiler temperature; (a) thermal efficiency of ORC, (b) total system thermal efficiency, and (c) total system exergy efficiency

will be determined if R600a is preferred as working fluid for this system. At another figure, fig. 4(b), the change of total system thermal efficiency due to evaporator temperature has been shown. As it can be seen from figure that increase in evaporator temperature affects positively. At given range, system reaches maximum value of efficiency up to 28% with R141b at 5 °C where the smallest values have been determined by using R600a. In fig. 4(c), variation of total system exergy efficiency against evaporator temperature has been indicated. As it seems from figure exergy efficiency of the system is negatively affected as a result of closing dead state temperature by increase in evaporator temperature at given range. The greatest value of exergy efficiency, near 10% has been obtained, again, with R141b at the smallest evaporator temperature which is -5 °C at given range. The worst performance has been shown by R600a for this parameter.

Effect of the condenser temperature

To determine effect of the condenser temperature to the system performance parameters boiler and evaporator temperatures are fixed at 100 °C and 0 °C, respectively. As it is clearly seen from fig. 5 that, if the system is operated at high condenser temperatures performance of the system will be low. In figs. 5(a) and 5(b), variation of thermal efficiency of the total system and thermal efficiency of the ORC system due to condenser temperature has been shown. Because of high cooling load in compressor, high turbine work output is required and this causes increase in heat input at boiler as a result of high condenser temperature. It can be seen from eqs. (1) and (11) that, high boiler heat input reduces ORC and total system thermal ef-

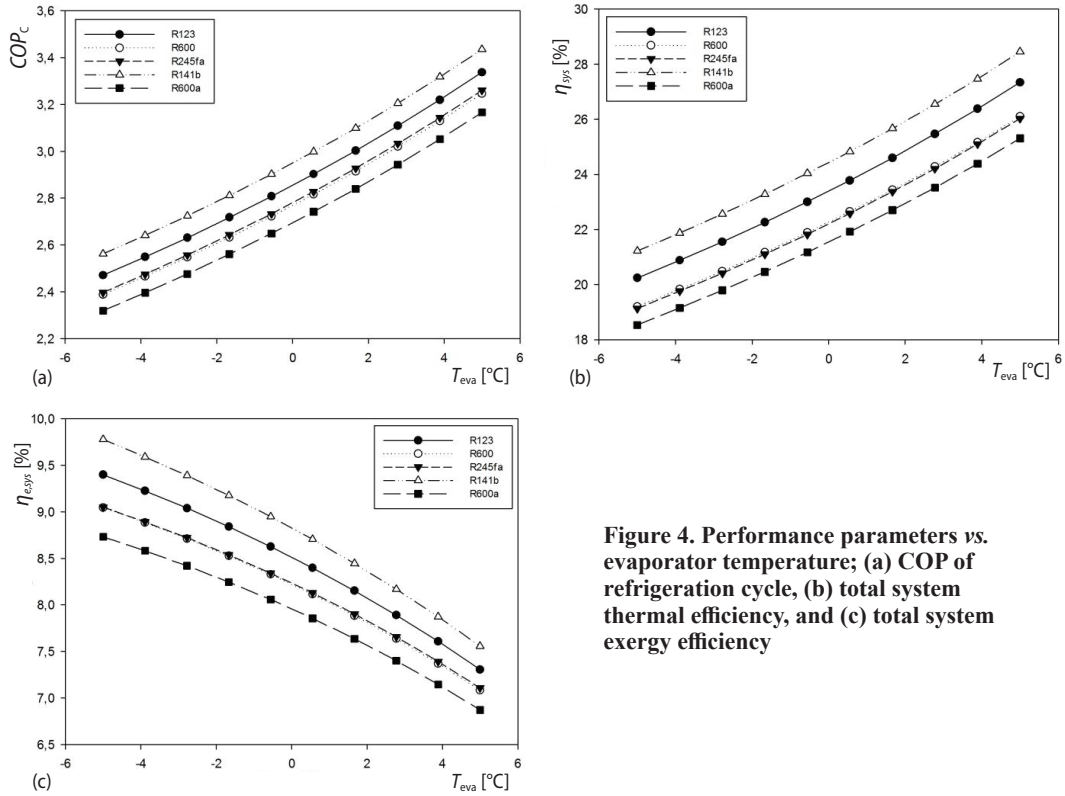


Figure 4. Performance parameters vs. evaporator temperature; (a) COP of refrigeration cycle, (b) total system thermal efficiency, and (c) total system exergy efficiency

Table 3. Exergy losses and exergy efficiencies of the components

Component	Destroyed exergy [kW]	Power input/output [kW]	Exergy efficiency [%]
Evaporator	0.1322	135.4	98.7
Condenser	56.48	696.5	2.1
Expansion valve	0.8515	—	0
Boiler	10.48	577.4	90.8
Compressor	50.05	47.42	58.4
Pump	2.891	1.592	81.7
Mixing chamber	0.012	—	0
Turbine	24.69	47.42	65.8
Total system	145.6	—	8.5

$T_{con} = 45$ °C). As a result of the calculations, the greatest exergy lost occurred in condenser because of high heat rejection resulting high heat loss. At mixing chamber because of adiabatic mixing, exergy loss nearly zero. Exergy loss value of the total system is 145.6 kW and exergy efficiency of the system 8.5% for these boiler, evaporator, and condenser temperatures.

efficiency. Between five different working fluids, R141b is the best at either low and high condenser temperatures. The smallest values are obtained by using R600a and R245fa for the total system and ORC system, respectively. In fig. 5(c), one can see that exergy efficiency of the system will decrease as a result of high exergy input to the system. As it is well known, high condenser temperatures cause reduction in COP at typical refrigeration cycles.

For R123, destroyed exergy and exergy efficiency of components shown in tab. 3 ($T_{boi} = 100$ °C, $T_{eva} = 0$ °C, and

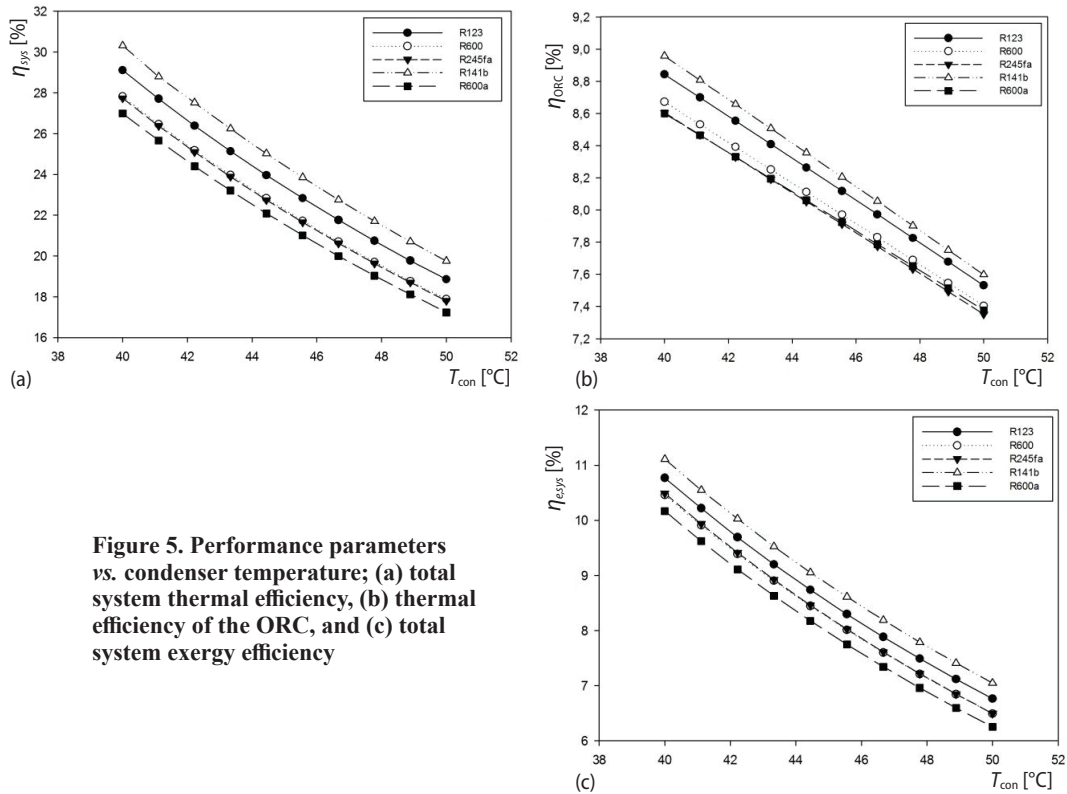


Figure 5. Performance parameters vs. condenser temperature; (a) total system thermal efficiency, (b) thermal efficiency of the ORC, and (c) total system exergy efficiency

Conclusions

In this study, exergy and energy analysis of a combined refrigeration and waste heat sourced ORC has been done. Five different working fluids has been used as working fluid, which are R123, R600, R600a, R245fa, and R141b, energy and exergy performance of the system analyzed due to change in boiler, evaporator, and condenser temperatures at specified intervals.

It can be easily understood from the results that, R141b is the most suitable organic fluid between these five different fluids for the given parameters. Frequently used organic fluid in ORC systems, R245fa, seems to be not appropriate organic fluid for this system since its performance very low compare to R141b and R123.

Since evaporator and condenser temperatures is constant, if the system is operated at high boiler temperatures both energy and exergy performance of the system will be better. High evaporator temperatures decrease cooling load resulting greater COP values but despite that it adversely effects the exergy efficiency of the system. Thermal efficiency and exergy efficiency of the system will dramatically decrease when the condenser temperature is increased. It causes almost 10%, 2%, and 4% reduction in thermal efficiency of the system, thermal efficiency of the ORC system and exergy efficiency of the system, respectively, for each working fluid. According to that results, it can be understood that the best working fluid for the purposed system is R141b and the optimum working temperature conditions are high boiler temperature, medium evaporator temperature, and low condenser temperature.

In this study, dry and isentropic type working fluids were chosen particularly, despite that R141b was specified as the best working fluid, life-cycle cost analysis (LCCA) is significant beside energy and exergy analysis, before making the last decision for working fluid. In LCCA, the most appropriate result can be attained when investment cost (cost of turbine, compressor, heat exchangers, pump, expansion valve, etc.), assembly and commissioning cost, operating cost, maintain and service cost are considered.

Nomenclature

\dot{E} –exergy flow, [kW]
 h –enthalpy, [kJkg⁻¹]
 I –destroyed exergy, [kW]
 \dot{m} –mass flow rate, [kgs⁻¹]
 P –pressure, [kPa]
 \dot{Q} –heat transfer rate, [kW]
 s –entropy, [kJkg⁻¹K⁻¹]
 T –temperature, [C]
 \dot{W} –power, [kW]

Greek symbols

η –efficiency, [%]
 ψ –specific exergy flow, [kJkg⁻¹]

Subscripts

boi –boiler
 C –cooling
 $c,isen$ – isentropic situation of compressor
 c,mec – mechanical efficiency of compressor
 comp – compressor

con –condenser
 e –exergy
 eva –evaporator
 exp –expansion valve
 in –input
 mix –mixing chamber
 ref –refrigeration cycle
 stc –combined turbine and compressor
 sys –total system
 $t,isen$ – isentropic situation of turbine
 t,mec – mechanical efficiency of turbine
 turb –turbine
 0 –dead state
 1-8 –state points of the cycle

Acronyms

COP –coefficient of performance
 EES –engineering equation solver
 ORC –organic Rankine cycle

References

- [1] Zhu, Q., et al., Performance Analysis of Organic Rankine Cycles Using Different Working Fluids, *Thermal Science*, 19 (2015), 1, pp. 179-191
- [2] Kaska, O., Energy and Exergy Analysis of an Organic Rankine for Power Generation from Waste Heat Recovery in Steel Industry, *Energy Conversion and Management*, 77 (2014), Jan., pp. 108-117
- [3] Ozdil, N. F. T., et al., Thermodynamic Analysis of an Organic Rankine Cycle (ORC) Based on Industrial Data, *Applied Thermal Engineering*, 91 (2015), Dec., pp. 43-52
- [4] Tahani, M., et al., A Comprehensive Study on Waste Heat Recovery from Internal Combustion Engines Using Organic Rankine Cycle, *Thermal Science*, 17 (2013), 2, pp. 611-624
- [5] Dai, Y., et al., Parametric Optimization and Comparative Study of Organic Rankine Cycle (ORC) for Low Grade Waste Heat Recovery, *Energy Conversion and Management*, 50 (2009), 3, pp. 576-582
- [6] Bu, X. et al., Performance Analysis and Working Fluids Selection of Solar Powered Organic Rankine-Vapor Compression Ice Maker, *Solar Energy*, 95 (2013), Sept., pp. 271-278
- [7] Masheiti, S., et al., An Evaluation of R134a and R245fa as the Working Fluid in an Organic Rankine Cycle Energized from a Low Temperature Geothermal Energy Source, *Journal of Energy and Power Engineering*, 5 (2011), Jan., pp. 392-402
- [8] Moro, R., et al., ORC Technology for Waste-Wood to Energy Conversion in the Furniture Manufacturing Industry, *Thermal Science*, 12 (2008), 4, pp. 61-73
- [9] Long, R., et al., Exergy Analysis and Working Fluid Selection of Organic Rankine Cycle for Low Grade Waste Heat Recovery, *Energy*, 73 (2014), Aug., pp. 475-483
- [10] Cihan, E., Cooling Performance Investigation of a System with an Organic Rankine Cycle Using Waste Heat Sources, *Journal of Thermal Science and Technology*, 34 (2014), 1, pp. 101-109
- [11] Li, H., et al., Hydrocarbon Working Fluids for a Rankine Cycle Powered Vapor Compression Refrigeration System Using Low-Grade Thermal Energy, *Energy and Buildings*, 65 (2013), Oct., pp. 167-172
- [12] Zheng, B., Weng, Y. W., A Combined Power and Ejector Refrigeration Cycle for Low Temperature Heat Sources, *Solar Energy*, 84 (2010), 5, pp. 784-791

- [13] Habibzadeh, A., *et al.*, Analysis of a Combined Power and Ejector-Refrigeration Cycle Using Low Temperature Heat, *Energy Conversion and Management*, 65 (2013), Jan., pp. 381-391
- [14] Dai, Y., *et al.*, Exergy Analysis, Parametric Analysis and Optimization for a Novel Combined Power and Ejector Refrigeration Cycle, *Applied Thermal Engineering*, 29 (2009), 10, pp. 1983-1990
- [15] Bertrand, F. T., *et al.*, Fluid Selection for a Low-Temperature Solar Rankine Cycle, *Applied Thermal Engineering*, 29 (2009), 11-12, pp. 2468-2476
- [16] Drescher, U., Bruggemann, D., Fluid Selection for the Organic Rankine Cycle (ORC) in Biomass Power and Heat Plants, *Applied Thermal Engineering*, 27 (2007), 1, pp. 223-228
- [17] Klein, S., A., *Engineering Equation Solver*, Academic Version 9.901, F-Chart Software, Madison, Wis., USA, 2015
- [18] Qui, G., *et al.*, Expanders for Micro-CHP Systems with Organic Rankine Cycle, *Applied Thermal Engineering*, 31 (2011), 16, pp. 3301-3307
- [19] Quoilin, S., *et al.*, Experimental Study and Modelling of an Organic Rankine Cycle Using Scroll Expander, *Applied Energy*, 87 (2010), 4, pp. 1260-1268
- [20] Kang, S., H., Design and Experimental Study of ORC and Radial Turbine Using R245fa fluid, *Energy*, 41 (2012), 1, pp. 514-524